



## **Addendum No. 3 – Roof Core Cut Information**

**Attached are locations and images of the recent roof core cuts for your information.**

**Corporate Office**  
324 Evans St  
Greenville  
NC 27858  
**Tel** 252.758.3746  
**Fax** 252.830.3954


**Raleigh Office**  
2300 Rexwoods Dr  
Suite 300  
Raleigh  
NC 27607  
**Tel** 919.784.9330  
**Fax** 919.784.9331

[www.eastgroup.com](http://www.eastgroup.com)


**ENGINEERING**  
-  
**ARCHITECTURE**  
-  
**SURVEYING**  
-  
**TECHNOLOGY**  
-

BY:	DATE:	DESCRIPTION:
DIS:	4/23/17	ISSUED FOR CONSTRUCTION
REV:	0	

PROJECT NO:	20160182
CLIENT PROJECT NO:	WORK ORDER NO. 22
PROJECT TITLE:	<b>CITY OF GREENVILLE POLICE FIRE-RESCUE HEADQUARTERS ROOF REPLACEMENT</b>
DRAWING TITLE:	<b>NEW WORK ROOF PLAN</b>

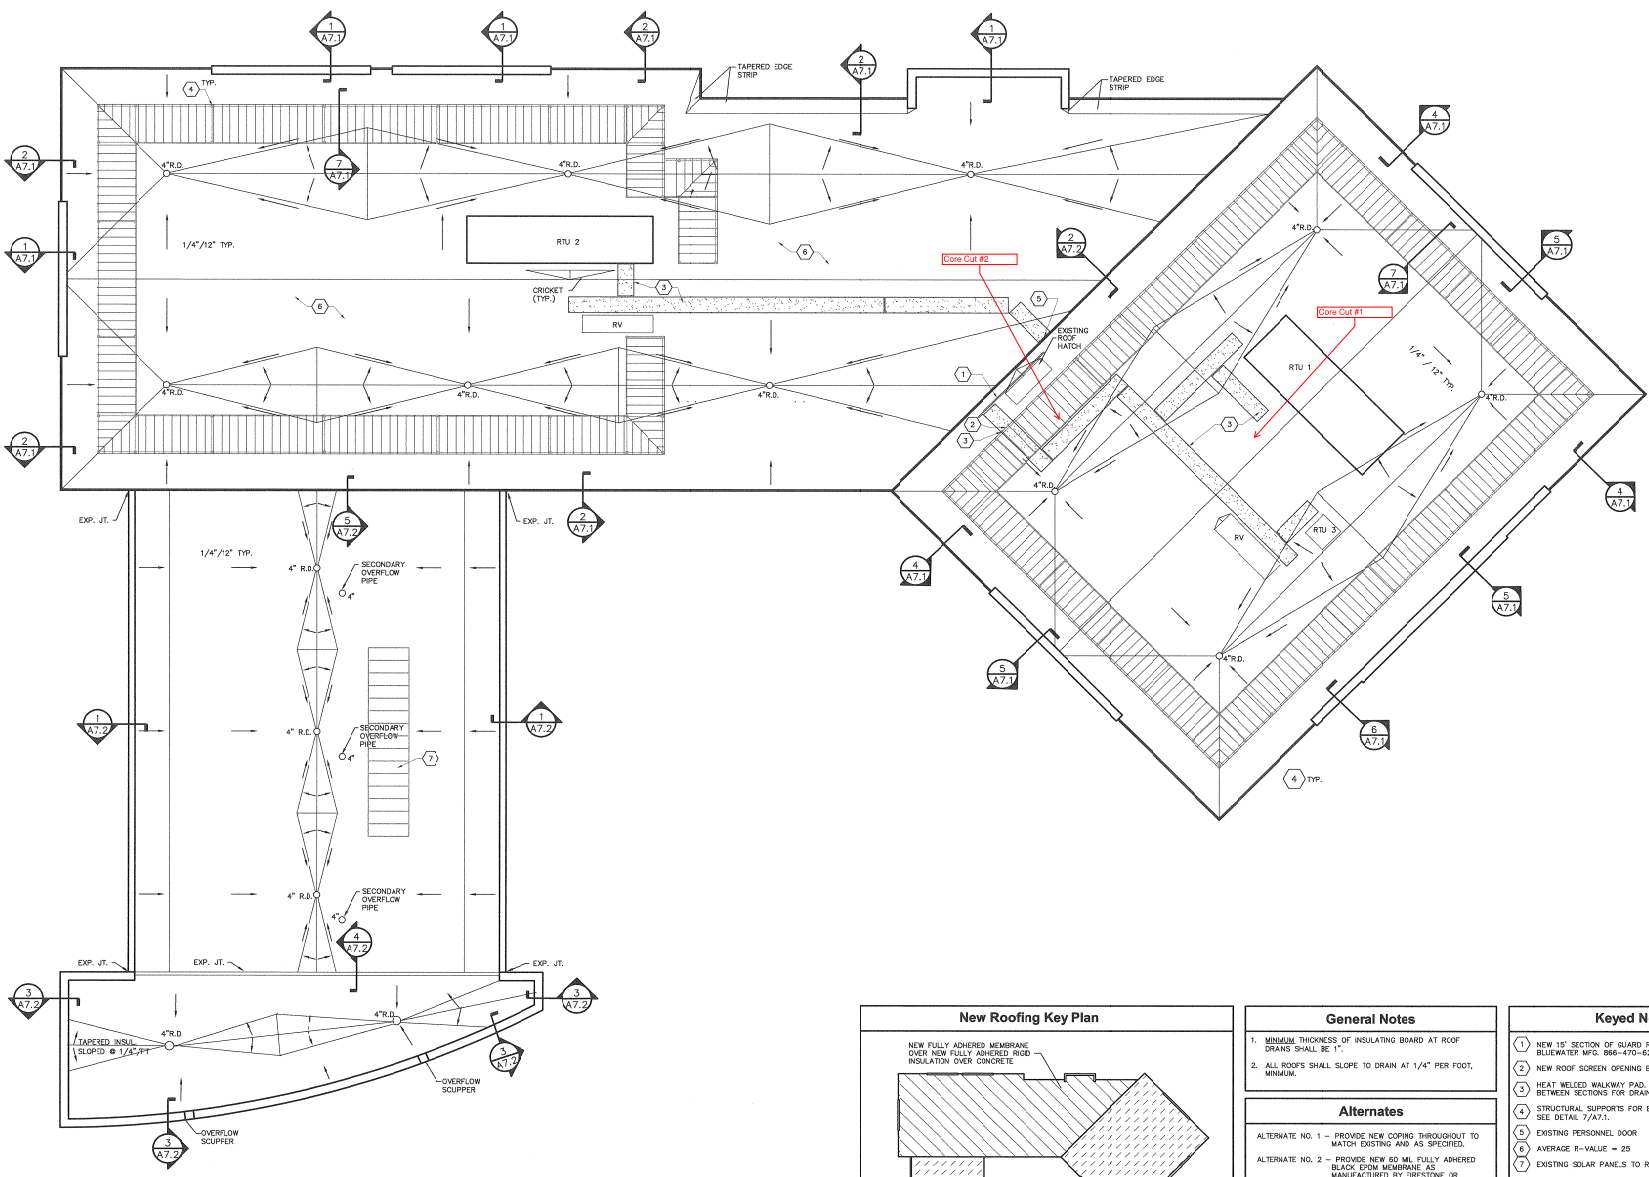

**1 ROOF PLAN**  
SCALE: 1/8" = 1'-0"

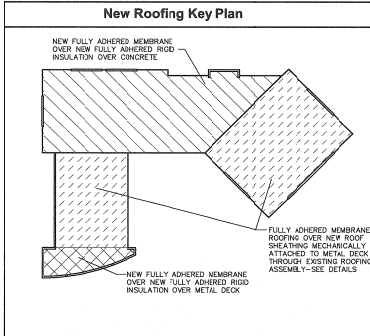

- General Notes**
- MINIMUM THICKNESS OF INSULATING BOARD AT ROOF DRAINS SHALL BE 1".
  - ALL ROOFS SHALL SLOPE TO DRAIN AT 1/4" PER FOOT, MINIMUM.
- Alternates**
- ALTERNATE NO. 1 - PROVIDE NEW COPING THROUGHOUT TO MATCH EXISTING AND AS SPECIFIED.
- ALTERNATE NO. 2 - PROVIDE NEW 60 MIL FULLY ADHERED BLACK EPDM MEMBRANE AS MANUFACTURED BY PRESTONE OR CARLISLE IN LIEU OF TPO MEMBRANE INDICATED FOR BASE BID.

- Keyed Notes**
- NEW 15' SECTION OF GUARD RAIL SAFETY/RAL 3000 BY BLUEWATER MFG. 886-470-6208 OR APPROVED EQUAL.
  - NEW ROOF SCREEN OPENING BY OTHERS.
  - HEAT WELDED WALKWAY PAD, MAINTAIN 2" SPACE BETWEEN SECTIONS FOR DRAINAGE.
  - STRUCTURAL SUPPORTS FOR EXISTING ROOF SCREEN - SEE DETAIL 7/A7.1.
  - EXISTING PERSONNEL DOOR
  - AVERAGE R-VALUE = 25
  - EXISTING SOLAR PANELS TO REMAIN

THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF THE EAST GROUP, P.A. ANY USE, REPRODUCTION OR DISSEMINATION OF THIS INFORMATION WITHOUT THE WRITTEN PERMISSION OF THE EAST GROUP, P.A. IS STRICTLY PROHIBITED. © COPYRIGHT 2017 THE EAST GROUP, P.A.





NYLO COAT  
KOMEIDON®  
5  
4  
DURA NY-Coat™  
3  
ft 25ft in  
2  
1

